

## Standard Features (Sizes 1/2" - 6")

- True Union design on all three ports
- Double O-ring seals on stem for added protection
- Integrally molded ISO mounting pad for both manual and actuated operations
- Blow-out proof, solid mold bottom entry design
- Blocks from left or right union ports, leaving full pressure on the opposite end of valve
- Standard "L" port ball permits flow from common port to either left or right port or to "OFF" position
- PTFE seats with elastomeric backing cushions ensure bubble-tight shut-off and a low fixed torque, while at the same time compensating for wear
- Built-in spanner wrench on the handle for valve disassembly and assembly
- · All sizes rated for full vacuum service
- Eliminates need for additional valve and "Tee"
   Options
- Pneumatic and electric actuators & accessories
- Stem extensions
- 2" square operating nut or "T" nut
- · Locking handles
- Limit switches
- "T" port, Double "L" port

#### Cross Port Ball Options [1/2" - 2" only]

- 4 different flow patterns through 3 separate ports are possible because of the crossed flow patterns within the ball
- Changing position of handle changes flow pattern. Handle rotates 360°

Specifications

**Sizes:** 1/2" - 6"

Models: PVC & CPVC: Socket, Threaded

and Flanged (ANSI)

Bodies: PVC, CPVC, PP, PVDF

Seats: PTFE backed with EPDM or FKM

Seals: EPDM or FKM or AFLAS®†

Sizes 1/2" - 4" PVC/EPDM/FKM Models NSF-61 Certified

† Trademark of Asahi Glass Co., Ltd.

### Parts List (Sizes 1/2" - 6")

PARTS										
NO.	DESCRIPTION	PCS.	MATERIAL							
1	Body	1	PVC, CPVC, PP, PVDF							
2	Ball	1	PVC, CPVC, PP, PVDF							
3	Carrier	2	PVC, CPVC, PP, PVDF							
4	End Connector	3	PVC, CPVC, PP, PVDF							
5	Union Nut	3	PVC, CPVC, PP, PVDF							
6	Stem	1	PVC, CPVC, PP, PVDF							
7	Seat	2	PTFE							
8	O-Ring (A)	3	EPDM, FKM, Others							
9	O-Ring (B)	2	EPDM, FKM, Others							
10	Cushion*	2	EPDM, FKM, Others							
10	O-Ring (C)**		Er Divi, i Rivi, Others							
11	O-Ring (D)	1	EPDM, FKM, Others							
12	O-Ring (E)	1	EPDM, FKM, Others							
13	Stop Ring***	3	PVDF							
14	Handle	1	ABS							
15	Screw	1	304 Stainless Steel							
4a	Ring****	3	304 Stainless Steel							

<sup>\*</sup> Used for size 1/2" - 2", \*\*Used for size 3" and 4"


<sup>\* \* \* \*</sup> Used for CPVC body, threaded end, 1/2" - 1"



<sup>\* \* \*</sup> Used for flanged end

# Type 23

# Multiport® Ball Valves

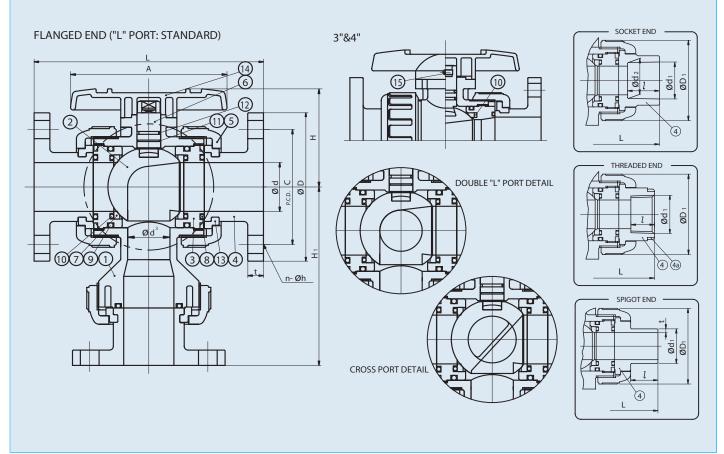

## **Dimensions (Sizes 1/2" – 4")** For 6" size consult factory.

NOM	ΙΝΙΔΙ		FLANGED						THRE				)				
	ZE			ANSI CLASS 150						PP, PVDF (IPS)							
INCHES	mm	d	$d^3$	D	С	n	h	L	t	H1	d1	l	L	H1	d1	l	t
1/2	15	0.59	0.59	3.50	2.38	4	0.62	5.63	0.47	3.70	1/2-14 NPT	0.59	4.02	2.89	1.89	2.03	3.62
3/4	20	0.79	0.79	3.88	2.75	4	0.62	6.77	0.55	4.50	3/4-14 NPT	0.67	4.72	3.48	2.36	2.34	3.94
1	25	0.98	0.98	4.25	3.12	4	0.62	7.36	0.55	5.24	1-11 1/2 NPT	0.79	5.16	4.13	2.76	2.68	4.33
1 1/2	40	1.57	1.26	5.00	3.88	4	0.62	8.35	0.63	6.50	1 1/2-11 1/2 NPT	0.98	6.42	5.53	3.94	3.50	5.16
2	50	2.01	1.69	6.00	4.75	4	0.75	9.21	0.63	7.34	2-11 1/2 NPT	1.10	7.76	6.61	4.96	4.04	6.26
3	80	3.07	2.70	7.50	6.00	4	0.75	11.97	0.71	10.06	3-8 NPT	1.38	10.39	9.25	5.98	5.51	9.45
4	100	3.94	3.54	9.00	7.50	4	0.75	14.65	0.71	12.01	4-8 NPT	1.77	14.17	11.77	8.27	7.01	12.01


		SOCKET											SPIGOT (BUTT END)								
NOM SI	INAL ZE	PVC, CPVC		PVC, CPVC PP, PVDF (DIN)					PP, PVDF (IPS)				PP, PVDF								
		ANSI SCH 80/40				DIN 16962		2							DIN	3442	PP	PVDF			
INCHES	mm	d1	d2	l	L	H1	d1	d2	l	L	H1	d1	l	L	H1	d1	l	t	t	L	H1
1/2	15	0.848	0.836	0.875	4.45	3.08	0.768	0.760	0.57	3.90	2.80	0.83	0.87	4.45	3.09	0.787	0.728	0.098	0.075	4.88	3.27
3/4	20	1.058	1.046	1.000	5.08	3.56	0.965	0.957	0.63	4.49	3.27	1.03	1.00	5.08	3.61	0.984	0.866	0.106	0.075	5.67	3.90
1	25	1.325	1.310	1.125	5.75	4.32	1.240	1.232	0.71	4.84	3.94	1.30	1.13	5.75	4.37	1.260	0.886	0.118	0.094	6.06	4.53
1 1/2	40	1.912	1.894	1.375	7.24	5.71	1.947	1.937	0.93	5.83	5.16	1.89	1.37	7.24	5.85	1.969	1.260	0.181	0.118	6.85	6.02
2	50	2.387	2.369	1.500	8.23	6.66	2.461	2.445	1.08	6.93	6.06	2.36	1.50	8.23	6.76	2.480	1.417	0.228	0.118	8.82	7.01
3	80	3.516	3.492	1.875	11.10	9.59	3.512	3.498	1.40	9.88	8.82	3.48	1.87	11.10	11.10	3.543	1.496	0.323	0.169	11.61	9.69
4	100	4.518	4.491	2.000	13.90	11.58	4.293	4.278	1.63	12.20	10.98	4.48	2.25	14.37	14.37	4.331	1.752	0.394	0.209	12.72	11.85

# Multiport® Ball Valves


### Pressure vs. Temperature (PSI, WATER, NON-SHOCK)

NOMINAL			PVC		CPVC					PP		PVDF			
SI	ZE	30° F	71° F	106° F	30° F	121° F	141° F	176° F	-5° F	86° F	141° F	-5° F	141° F	176° F	196° F
INCHES	mm	70° F	105° F	120° F	120° F	140° F	175° F	195° F	85° F	140° F	175° F	140° F	175° F	195° F	210° F
1/2-2	15-50	150	150	150	150	120	85	55	150	90	60	150	120	110	85
3-4	80-100	150	150	150	150	85	55	45	150	75	45	150	100	85	70


#### **Available Flow Patterns** L-Port

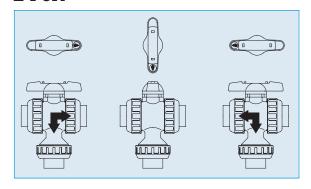


#### Double L-Port



### **T-Port**



## Cross Port (1/2" - 2" only)

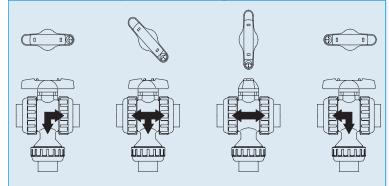

#### Automation

#### For Pneumatic Actuation:

"Double L-Port" ball is supplied as a standard feature. Other configurations available as options. Pneumatic actuators are 2 position, 90° Rotation.

#### For Electrical Actuation:

"L-Port" ball is supplied as a standard feature. All other ball configurations are available as options. Electrical actuators are 2 position, 180° Rotation with the option for a third "Center" position.

# Type 23

# Sample Specification

All Type 23 Multiport ball valves shall be of molded thermoplastic construction with union end on all three ports. Carriers must thread into the body in order to provide blocking capabilities in OFF position. Stem shall have double O-Rings and be of blow out proof design. The valve handle shall double as carrier removal and/or tightening tool. ISO mounting pad shall be integrally molded to valve body. PVC conforming to ASTM D1784 Cell Classification 12454-A, CPVC conforming to ASTM D1784 Cell Classification 23567-A, PP conforming to ASTM D4101 Cell Classification PP0210B67272 and PVDF conforming to ASTM D3222 Cell Classification Type II. The valves shall be rated to 150 psi at 70° F. PTFE seats must have elastomeric backing cushion of the same material as the valve seals, as manufactured by Asahi/America, Inc.

#### Caution

- Never remove valve from pipeline under pressure.
- Always wear protective gloves and goggles.
- Watch out for trapped fluid in valve.
- Only L-port and T-port valves are closed when Handle is positioned perpendicular (90 degrees).
- Even if handle is perpendicular, valve is not closed if the ball is in the following positions, based upon the following porting configurations:
  - (a.) Double L-Port Flow is to right or left
  - (b.) *Cross-Port* Flow is horizontal as in regular ball valve.

### Cv Values

## Weight (POUNDS)

						_	`	,		
NOMINAL SIZE		С	:V		NOM SIZ		SOCKET THREADED	FLANGED		
INCHES	mm	L-PORT	DBL-L	IN	ICHES	mm	TTIKENDED			
1/2	15	7.4	6.3		1/2	15	0.66	1.76		
3/4	20	10	8.5		3/4	20	1.10	2.42		
1	25	23	20		1	25	1.76	3.52		
1 1/2	40	43	36	1	1/2	40	4.18	6.36		
2	50	59	45		2	50	5.73	8.59		
3	80	130	99		3	80	15.43	18.95		
4	100	260	200		4	100	35.27	39.90		
				_						

# Multiport® Ball Valves

### **Troubleshooting**

#### What if the fluid still flows when valve is closed?

- 1. Carrier is not properly tightened. Tighten it firmly.
- 2. PTFE seat is damaged or worn. Replace seat.
- 3. Foreign material is caught between ball and PTFE seat. Remove material and clean.
- 4. Ball is damaged or worn. Change ball.

#### What if fluid leaks between body and nuts?

1. Carrier or face O-ring is damaged, worn, or missing. Replace O-ring.

#### What if stem leaks?

- 1. Stem is damaged. Replace stem.
- 2. O-ring is damaged. Replace O-ring.

#### What if handle does not rotate smoothly?

- 1. Foreign material has formed on the ball or seat. Clean both.
- 2. Internal part(s) chemically attacked or swollen. Refer to Asahi/America Chemical Resistance Chart for compatibility. Replace part(s) as required.
- 3. Carrier over-tightened. Tighten properly.

#### What if handle rotates too freely?

- 1. Stem is damaged. Replace stem.
- 2. Handle is not engaged with stem.

  Disassemble and reengage. Inspect.