




Series 647 Wet/Wet Differential Pressure Transmitter

Specifications - Installation and Operating Instructions

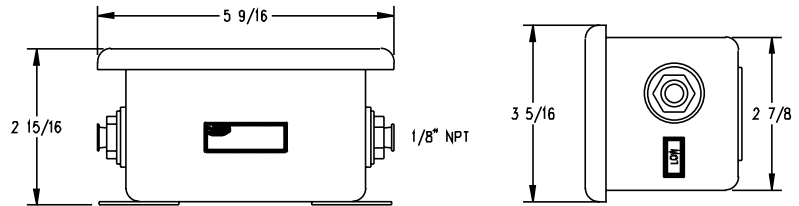

GENERAL

The Series 647 Wet/Wet Differential Pressure Transmitter is designed for use with compatible liquids or gases and can accurately measure differential pressure down to 1" H₂O. The transmitter contains a fast response piezoresistive sensor and a unique isolation system ideal for HVAC systems, filter monitoring, variable speed drive control, air/liquid flow monitoring, and process control.

The Series 647 Wet/Wet Differential Pressure Transmitter features excellent repeatability, low hysteresis, and accurate operation over a broad temperature range. Units have an adjustable zero and span and feature reverse polarity protection.

MECHANICAL INSTALLATION

NOTE: The Series 647 Wet/Wet Differential Pressure Transmitter can be mounted in any position, however, be alert to moisture passing through a non-waterproof electrical connector.

The unit can measure gauge, vacuum, or differential pressure. Follow the directions below for the appropriate port connections.

Gauge (Positive) pressure sensing: Connect media pressure to port labeled "HIGH", with port labeled "LOW" vented to atmosphere.

Vacuum (Negative) pressure sensing: Connect media pressure to port labeled "LOW", with port labeled "HIGH" vented to atmosphere.

Differential pressure sensing: Connect the higher of the two media pressures to port labeled "HIGH", and the lower of the two pressures to port labeled "LOW".

PHYSICAL DATA

Service: Compatible gases or liquids on both pressure and reference sides.

Accuracy: ±1.0% FS.

Output: 4 to 20 mA, 2-wire.

Supply Voltage: 18 to 30 VDC.

Loop Resistance: 400Ω @ 18 VDC, 600Ω @ 24 VDC, 1000Ω @ 30 VDC.

Zero and Span: Adjustable, ±10%.

Max Line Pressure: 60 psig.

Max Overload Pressure: Ranges 1" w.c. to 5 psi: 20 psi, 15 psi range: 45 psi, 30 psi range: 60 psi.

Compensated Temperature Range: 32 to 122°F (0 to 50°C).

Storage Temperature: -40 to 212°F (-40 to 100°C).

Thermal Effects: Zero: ±0.05% FS/°F, Span: ±0.05% rdg/°F.

Stability: ±1.5% FS output/year.

Wetted Parts: Brass, vinyl, glass-filled polyester, silicon, Buna-N, and fluorosilicon.

Housing: Gasketed steel epoxy painted, NEMA 4.

Process Connection: 1/8" NPT(F).

Electrical Connection: Screw terminals, reverse polarity protected.

Weight: 14 oz (397 g).

MODELS

Model Number	Range	Model Number	Range
647-0	0 to 1" w.c.	647-5	0 to 1 psid
647-1	0 to 3" w.c.	647-6	0 to 5 psid
647-2	0 to 25" w.c.	647-7	0 to 15 psid
647-3	0 to 5" w.c.	647-8	0 to 30 psid
647-4	0 to 10" w.c.		

The Series 647 Wet/Wet Differential Pressure Transmitters have 1/8 NPT female port connections. ALWAYS USE A SECOND WRENCH TO HOLD THE PORT HEX NUT, THEREBY ELIMINATING THE POSSIBILITY OF ROTATING THE BRASS PORT FITTING. Use thread sealant or teflon tape to insure proper sealing.

DWYER INSTRUMENTS, INC.

P.O. BOX 373 • MICHIGAN CITY, INDIANA 46361 U.S.A.

Phone 219/879-8000

Fax 219/872-9057

Lit-by-Fax: 888/891-4963

www.dwyer-inst.com

e-mail: info@dwyer-inst.com

ELECTRICAL CONNECTIONS

Make all wiring connections with the power off. All circuits must be wired to the National Electrical Code, Class 1, and in conformance with all applicable codes and requirements with approved wiring practices. See Figure 1 below for appropriate wiring connections.

Wiring Connections

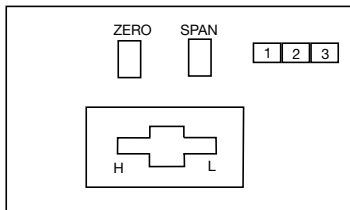
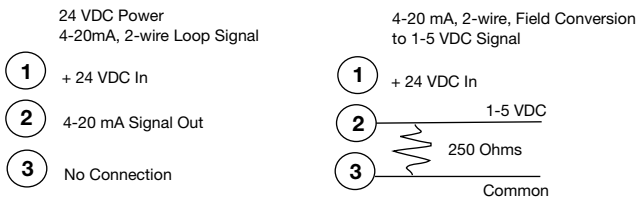


Figure 1

OPERATION

After applying power, allow approximately 20 to 30 minutes for stabilization of signal.

When operating at low differential pressures of less than 5" w.c. or in applications where the pressure is fluctuating rapidly—it is advisable to insert “snubbers” for air flow restrictors in the input lines. This serves to “steady” the output signal and keeps the signal from bouncing erratically.

Adjustments:

The Series 647 transmitters are adjusted for the specified range at the factory and should not require further adjustments. If necessary or desirable, the zero and span may be adjusted, however, the requested full scale range as shipped is established with fixed resistors minimizing the range of adjustment. The average full scale adjustment is $\pm 10\%$ of the range shipped.

“Z” - Zero Control is adjusted for 4 mA output signal at 0 psi or minimum pressure.

“S” - Span Control is adjusted to change the full scale range of the transmitter.

Due to resistor values required to compensate for the null off-set of the sensing module, evidence of Zero and Span interaction may be experienced in readjusting.

Do not adjust the bridge balance and temperature compensation controls.

WARNING

Fluid hammer and surges can destroy any pressure transducer and must always be avoided. A pressure snubber should be installed to eliminate the damaging hammer effects.

Fluid hammer occurs when a liquid flow is suddenly stopped, as with quick closing solenoid valves. Surges occur when flow is suddenly begun, as when a pump is turned on at full power or a valve is opened quickly.

MAINTENANCE

After final installation of the Series 647 Wet/Wet Differential Pressure Transmitter, no routine maintenance is required. Periodic checks of connections is recommended. Please contact Dwyer Instruments, Inc. before returning unit for repair to review information relative to your application. When returning a product to the factory, carefully package and ship freight prepaid. Be sure to include a complete description of the application and problem and identify any hazardous material used with the product.

